


1. CURB RADII SHALL BE A MINIMUM 30' MEASURED TO BACK OF CURB FOR STREETS CLASSIFIED AS COLLECTOR OR BELOW, 40' FOR MINOR ARTERIALS AND 50' FOR MAJOR ARTERIALS.
2. DRIVEWAY APRON SHALL BE 6" THICK (MIN.).
3. REINFORCING BAR OR WIRE SHALL BE INSTALLED IN ALL COMMERCIAL DRIVEWAYS.
4. IF THERE IS NO SIDEWALK, THE DRIVEWAY APRON SHALL BE 6' AS MEASURED PERPENDICULAR FROM BACK OF CURB OR EDGE OF PAVEMENT.
5. EXPANSION JOINTS SHALL BE A MINIMUM OF 1/2" AND EXTEND THE FULL DEPTH OF THE CONCRETE. EXPANSION JOINT MATERIAL SHALL MEET AASHTO M213 FOR AN ASPHALTIC FIBER EXPANSION JOINT MATERIAL AND INSTALLED WITH A ZIP STRIP WHICH IS REMOVED AFTER THE CONCRETE HAS CURED AND SEALED WITH A MASTIC SEALER. OTHER ALLOWABLE EXPANSION JOINT MATERIAL ARE 1"x6" OR Z E 2"x6" PRESSURE TREATED PINE, REDWOOD OR WESTERN RED CEDAR WITH NAILS DRIVEN THROUGH EACH SIDE TO PREVENT THE BOARD FROM BEING PUSHED OUT OF THE JOINT.
6. CONTRACTION JOINTS TO BE PLACED IN CONCRETE DRIVEWAY SO THAT NO SLAB DIMENSION IS MORE THAN 15'.
7. ALL SIDEWALKS AND DRIVEWAYS TO RECEIVE A BROOM FINISH.
8. CONTACT THE CITY 24 HOURS PRIOR TO POURING CONCRETE FOR AN INSPECTION OF ALL SIDEWALKS AND DRIVEWAYS IN PUBLIC RIGHT OF WAY.
9. ALL CONCRETE FOR CURB, SIDEWALKS AND DRIVEWAYS SHALL BE CLASS B CONCRETE PER CITY SPECIFICATIONS (3500 PSI, 4-7% AIR ENTRAINED). CONCRETE MAY NOT BE POURED IF A FALLING AIR TEMPERATURE FALLS BELOW 40° F NOR RESUMED UNTIL AN ASCENDING AIR TEMPERATURE RISES ABOVE 35° F WITHOUT SPECIFIC AUTHORITY FROM THE CITY REPRESENTATIVE.
10. DRIVEWAY APRON AND MODIFIED CURB SHALL BE POURED MONOLITHICALLY.
11. REFER TO APPROVED PLANS FOR ACTUAL SIDEWALK AND GREENSPACE WIDTHS OR CONTACT CITY.

GUTTERLINE (NOT A SAW LINE OR JOINT)

MODIFIED CURB

EXPANSION JOINT EACH SIDE OF DRIVEWAY IF NOT POURED MONOLITHICALLY WITH THE REST OF THE CURB

IF NECESSARY TO REMOVE EXISTING CURB, A FULL DEPTH SAWCUT SHALL BE MADE AT CURB AND STREET PAVING JOINT. ANY DAMAGE TO THE STREET SHALL BE REPAIRED AT CONTRACTOR'S EXPENSE.

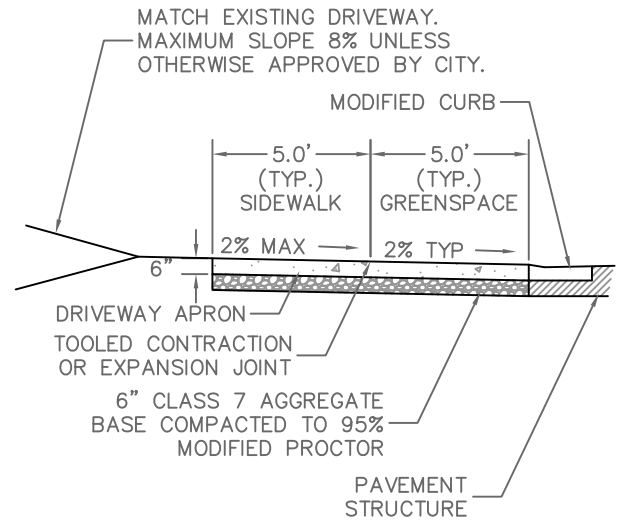

**CITY OF ROGERS**  
 301 WEST CHESTNUT STREET  
 ROGERS, ARKANSAS 72756  
 (479) 621-1186

# COMMERCIAL DRIVEWAY DETAIL

NOT TO SCALE

FEBRUARY 15, 2012